


<b>257.83 (b) (2)</b>	<b>REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT</b>		
	<b>FACILITY NAME:</b> Plant McIntosh AP-1, Cell A		
	<b>OWNER/OPERATOR OF FACILITY:</b> Georgia Power Company		
	<b>INSPECTION DATE:</b> October 26, 2017		
	<b>INSPECTING ENGINEER:</b> Patrick B. Rhodes, P.E. (Georgia P.E. License #024586)		
<b>(i)</b>	<b>ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		
<b>(ii)</b>	<b>LOCATION AND TYPE OF EXISTING INSTRUMENTATION</b>	<b>SEE ATTACHED PLAN</b>	
<b>(ii)</b>	<b>MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION</b>	<b>SEE ATTACHED TABLE</b>	
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION (ft)</b>		
	MIN. DEPTH: 19	MAX. DEPTH: 21	PRESENT DEPTH: 19.9
	MIN. ELEVATION: 58.5	MAX. ELEVATION: 60.5	PRESENT. ELEVATION: 59.4
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION. (ft)</b>		
	MIN. DEPTH: 4	MAX. DEPTH: 21	PRESENT DEPTH: 19.5
	MIN. ELEVATION: 43.5	MAX. ELEVATION: 60.5	PRESENT ELEVATION: Varies
<b>(iv)</b>	<b>APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION. (yd3)</b>	<b>113,921</b>	
<b>(v)</b>	<b>APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION (yd3)</b>	<b>WATER: 90,000</b>	<b>CCR: 26,871</b>
<b>(vi)</b>	<b>ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		
<b>(vii)</b>	<b>ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		

- Cubic yard estimates are derived by qualified personnel from available information.



<b>257.83 (b) (2)</b>	<b>REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT</b>		
	<b>FACILITY NAME:</b> Plant McIntosh AP-1, Cell B		
	<b>OWNER/OPERATOR OF FACILITY:</b> Georgia Power Company		
	<b>INSPECTION DATE:</b> October 26, 2017		
	<b>INSPECTING ENGINEER:</b> Patrick B. Rhodes, P.E. (Georgia P.E. License #024586)		
<b>(i)</b>	<b>ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		
<b>(ii)</b>	<b>LOCATION AND TYPE OF EXISTING INSTRUMENTATION</b>	<b>SEE ATTACHED PLAN</b>	
<b>(ii)</b>	<b>MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION</b>	<b>SEE ATTACHED TABLE</b>	
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION (ft)</b>		
	MIN. DEPTH: 19	MAX. DEPTH: 21	PRESENT DEPTH: 19.7
	MIN. ELEVATION: 58.5	MAX. ELEVATION: 60.5	PRESENT. ELEVATION: 59.2
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION (ft)</b>		
	MIN. DEPTH: 3	MAX. DEPTH: 21	PRESENT DEPTH: 20.5
	MIN. ELEVATION: 42.5	MAX. ELEVATION: 60.5	PRESENT ELEVATION: Varies
<b>(iv)</b>	<b>APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION. (yd3)</b>	<b>135,807</b>	
<b>(v)</b>	<b>APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION (yd3)</b>	<b>WATER: 121,505</b>	<b>CCR: 12,285</b>
<b>(vi)</b>	<b>ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		
<b>(vii)</b>	<b>ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		

- Cubic yard estimates are derived by qualified personnel from available information

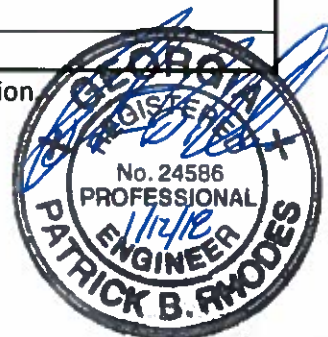

<b>257.83 (b) (2)</b>	<b>REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT</b>		
	<b>FACILITY NAME:</b> Plant McIntosh AP-1, Cell C		
	<b>OWNER/OPERATOR OF FACILITY:</b> Georgia Power Company		
	<b>INSPECTION DATE:</b> October 26, 2017		
	<b>INSPECTING ENGINEER:</b> Patrick B. Rhodes, P.E. (Georgia P.E. License #024586)		
<b>(i)</b>	<b>ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		
<b>(ii)</b>	<b>LOCATION AND TYPE OF EXISTING INSTRUMENTATION</b>	<b>SEE ATTACHED PLAN</b>	
<b>(ii)</b>	<b>MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION</b>	<b>SEE ATTACHED TABLE</b>	
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION (ft)</b>		
	MIN. DEPTH: 19	MAX. DEPTH: 21	PRESENT DEPTH: 19.7
	MIN. ELEVATION: 58.5	MAX. ELEVATION: 60.5	PRESENT. ELEVATION: 59.2
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION. (ft)</b>		
	MIN. DEPTH: 0*	MAX. DEPTH: 0*	PRESENT DEPTH: 0*
	MIN. ELEVATION: N/A	MAX. ELEVATION: N/A	PRESENT ELEVATION: N/A
<b>(iv)</b>	<b>APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION. (yd3)</b>	131,049	
<b>(v)</b>	<b>APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION (yd3)</b>	<b>WATER:</b> 135,000	<b>CCR:</b> 0*
<b>(vi)</b>	<b>ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		
<b>(vii)</b>	<b>ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		


\*All CCR was removed from Cell C in 2007.

- Cubic yard estimates are derived by qualified personnel from available information.



<b>257.83 (b) (2)</b>	<b>REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT</b>		
	<b>FACILITY NAME:</b> Plant McIntosh AP-1, Cell D		
	<b>OWNER/OPERATOR OF FACILITY:</b> Georgia Power Company		
	<b>INSPECTION DATE:</b> October 26, 2017		
	<b>INSPECTING ENGINEER:</b> Patrick B. Rhodes, P.E. (Georgia P.E. License #024586)		
<b>(i)</b>	<b>ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		
<b>(ii)</b>	<b>LOCATION AND TYPE OF EXISTING INSTRUMENTATION</b>	<b>SEE ATTACHED PLAN</b>	
<b>(ii)</b>	<b>MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION</b>	<b>SEE ATTACHED TABLE</b>	
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION (ft)</b>		
	MIN. DEPTH: 29	MAX. DEPTH: 31	PRESENT DEPTH: 29.8
	MIN. ELEVATION: 58.5	MAX. ELEVATION: 60.5	PRESENT. ELEVATION: 59.3
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION. (ft)</b>		
	MIN. DEPTH: 1.6	MAX. DEPTH: 1.6	PRESENT DEPTH: 1.6
	MIN. ELEVATION: 41	MAX. ELEVATION: 41	PRESENT ELEVATION: 41.1
<b>(iv)</b>	<b>APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION. (yd3)</b>	<b>31,924</b>	
<b>(v)</b>	<b>APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION (yd3)</b>	<b>WATER:28,658</b>	<b>CCR: 3,266</b>
<b>(vi)</b>	<b>ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		
<b>(vii)</b>	<b>ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	<b>(IF YES, DESCRIBE):</b>		

- Cubic yard estimates are derived by qualified personnel from available information.

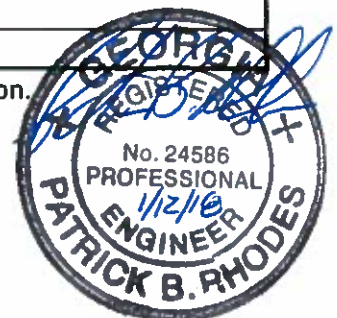

**MAXIMUM RECORDED READINGS OF INSTRUMENTATION  
PLANT MCINTOSH ASH POND**

**PIEZOMETERS**

<b>PIEZOMETER NUMBER</b>	<b>MAXIMUM RECORDED READING*</b>
M1	EL 48
M2	EL 45
M6	EL 49
M7	EL 28

\*MAXIMUM RECORDED READING SINCE LAST ANNUAL INSPECTION; ROUNDED TO NEAREST FOOT

**TOE DRAIN SUMP FLOWS\***

<b>PUMP NUMBER</b>	<b>MAXIMUM MEASURED FLOW</b>
A SUMP	4.7 gpm
C SUMP NORTH	1.6 gpm
C SUMP SOUTH	2.3 gpm

\*TOE DRAIN FLOWS COLLECTED IN A SUMP AND PUMPED BACK INTO ASH POND